


111

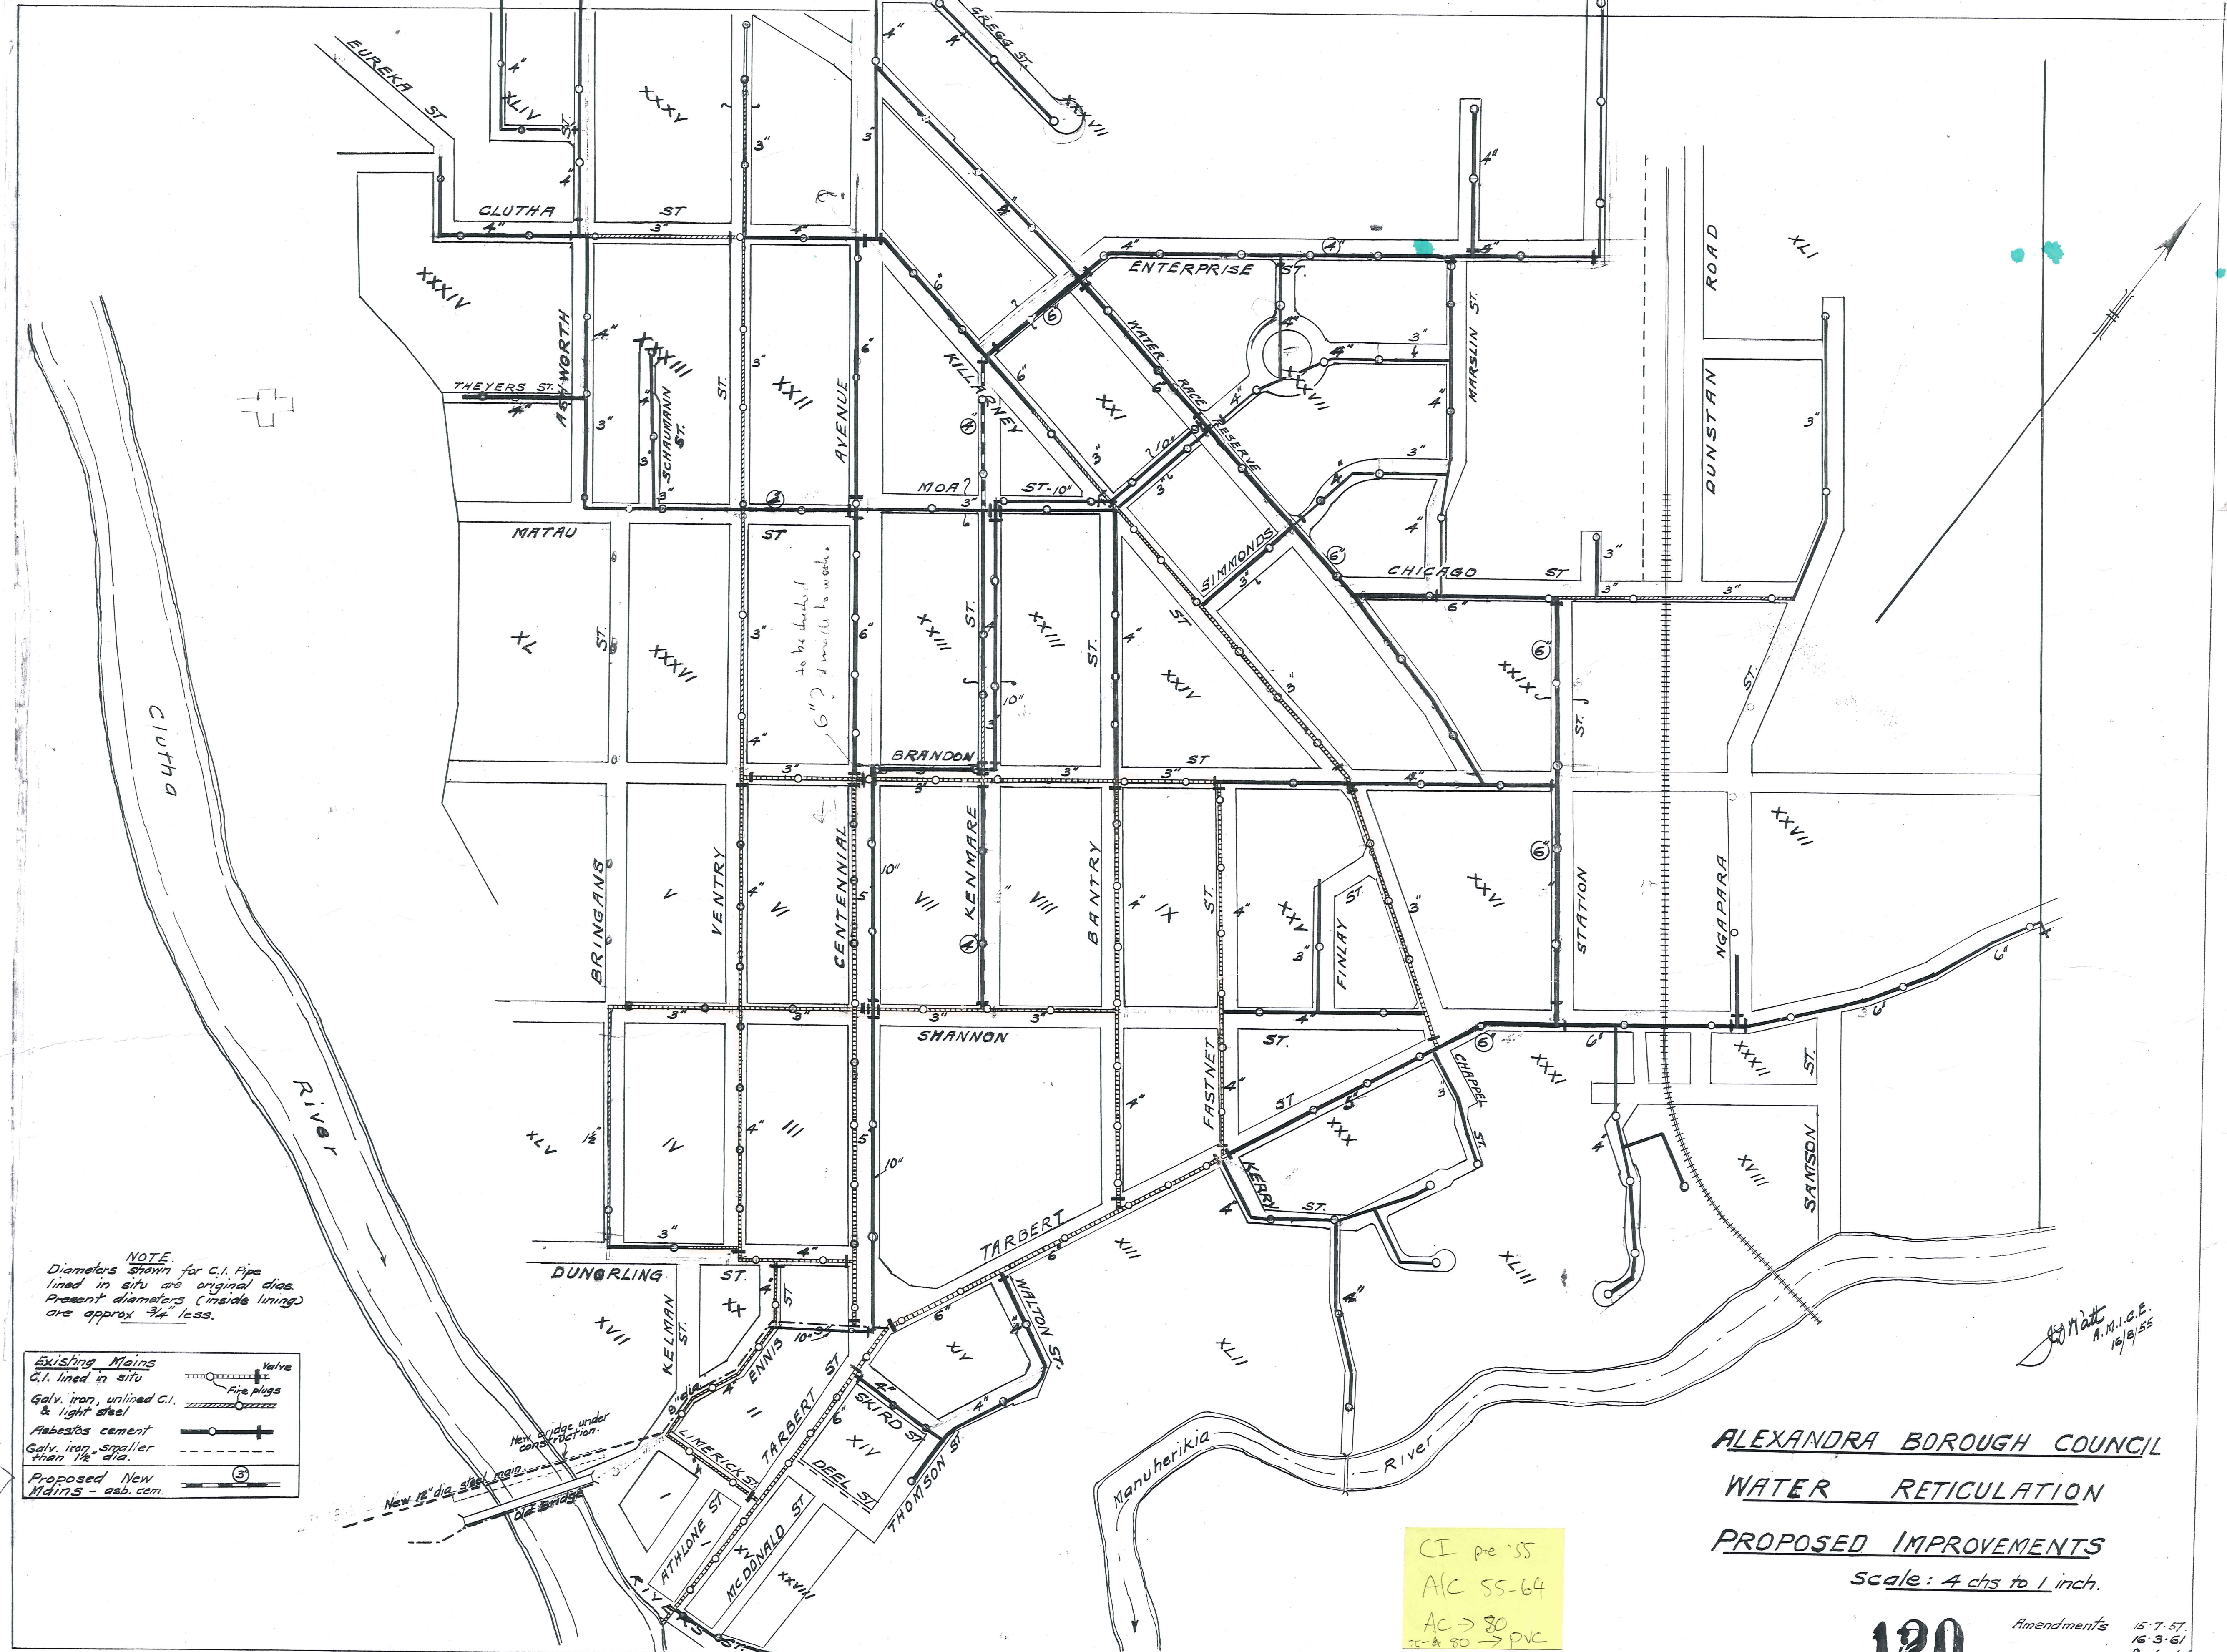

NOTE:
 Diameters shown for C.I. Pipe lined in situ are original dia. Present diameters (inside lining) are approx 3/4 less.

Existing Mains	Valve
C.I. lined in situ	pipe plugs
Galv. iron, unlined C.I. & light steel	Asbestos cement
Asbestos cement	Galv. iron, smaller than 1 1/2 dia.
Galv. iron, smaller than 1 1/2 dia.	Proposed New Mains - asb. cen.

W. H. H. A.M.I.C.E. 1913/55

ALEXANDRA BOROUGH COUNCIL
 WATER RETICULATION
 PROPOSED IMPROVEMENTS
 Scale: 4 dia to 1 inch.

CI pre '55
 A/C 55-64
 A/C -> 80
 75 & 80 -> PVC

120

Amendments
 15-7-57
 16-3-61
 9-6-64