



PERSPECTIVE VIEW NTS

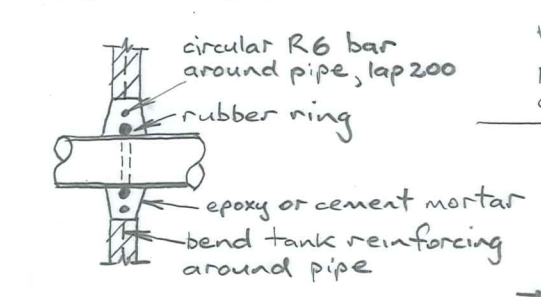

TANK INLET DETAIL NTS

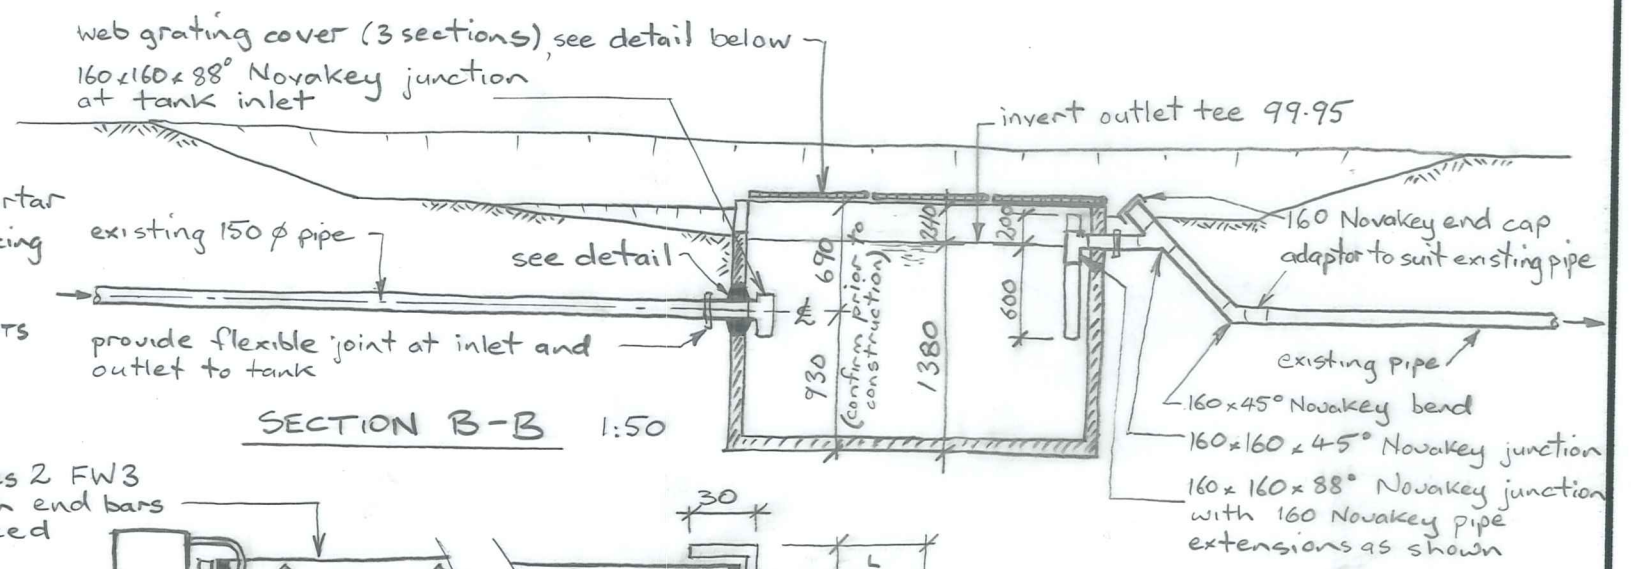


SECTION B-B 1:50

3 No. 1195 long x 763 wide Series 2 FW3 galv. web grating complete with end bars and 10 φ hole centrally placed one end for padlock.


Lockwood 234 padlock to each grating

130 long x 40 wide x 6 FMS bracket drilled for 12 φ fastening and 10 φ hole for padlock

ALL STEELWORK TO BE HOT DIP GALVANISED

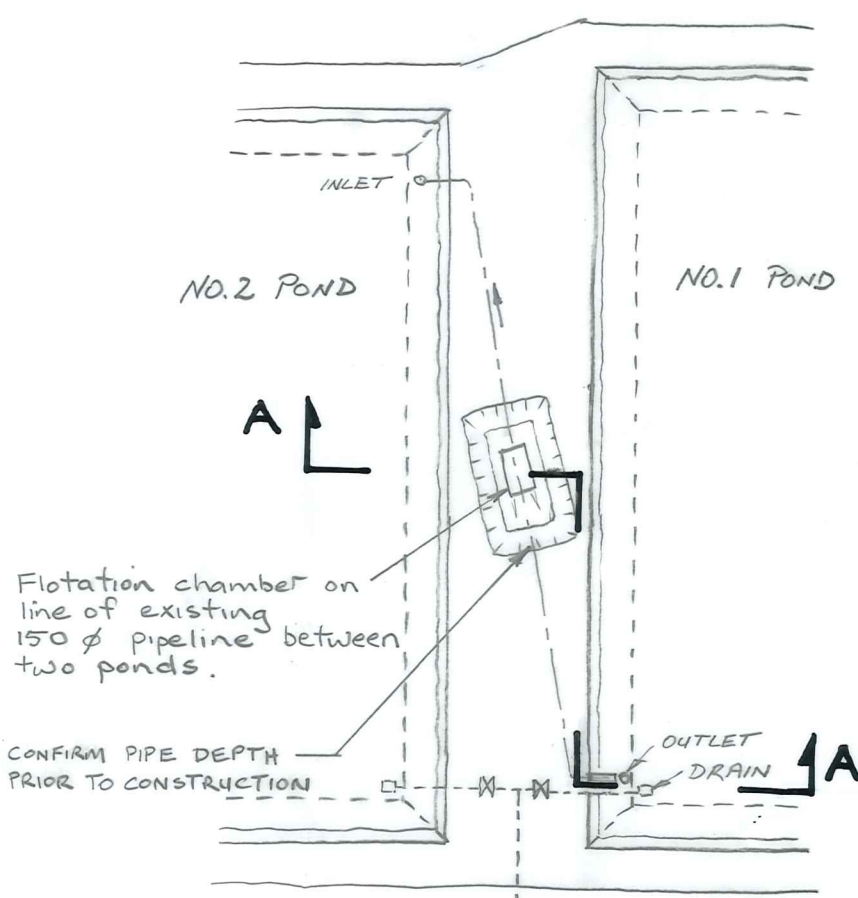

SITE PLAN NTS

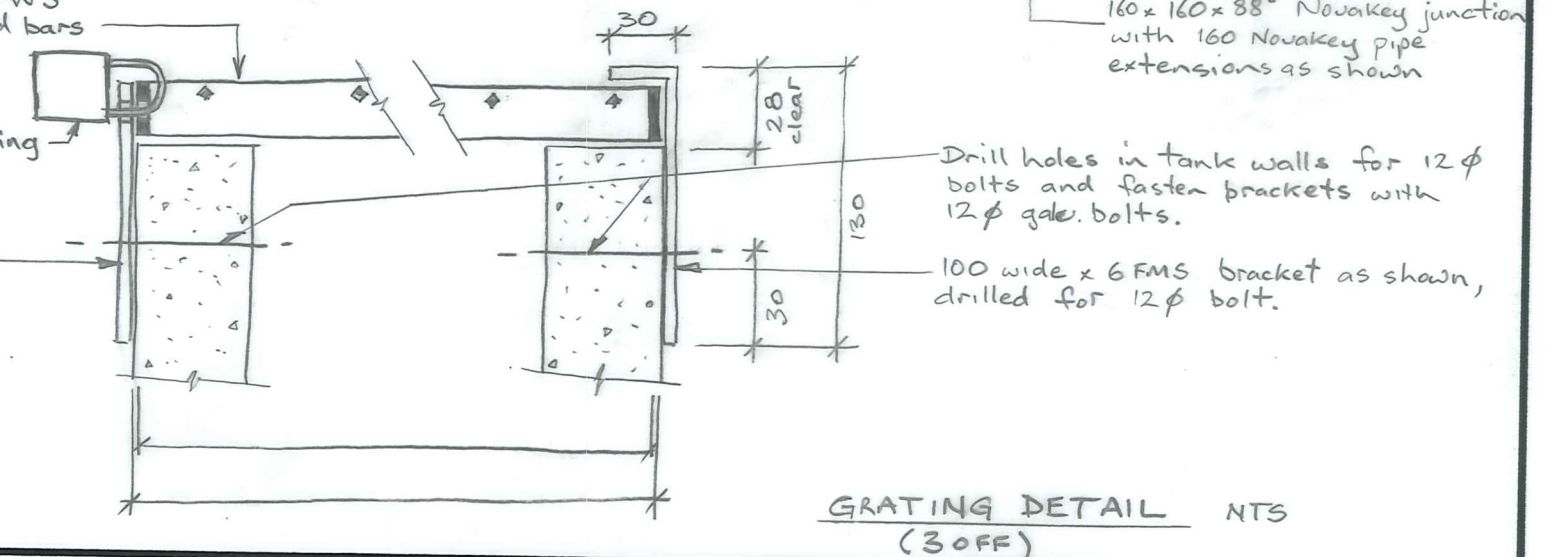

GRATING DETAIL NTS (3 OFF)

**Duffill Watts & King Ltd**  
CONSULTING ENGINEERS

CENTRAL OTAGO DISTRICT COUNCIL

OMAKAU OXIDATION PONDS  
FLOTATION CHAMBER

Job No. 12539/FC  
File No. 225/22/1/2  
Date: April 1991