


~PLAN~
Scale 1:1000

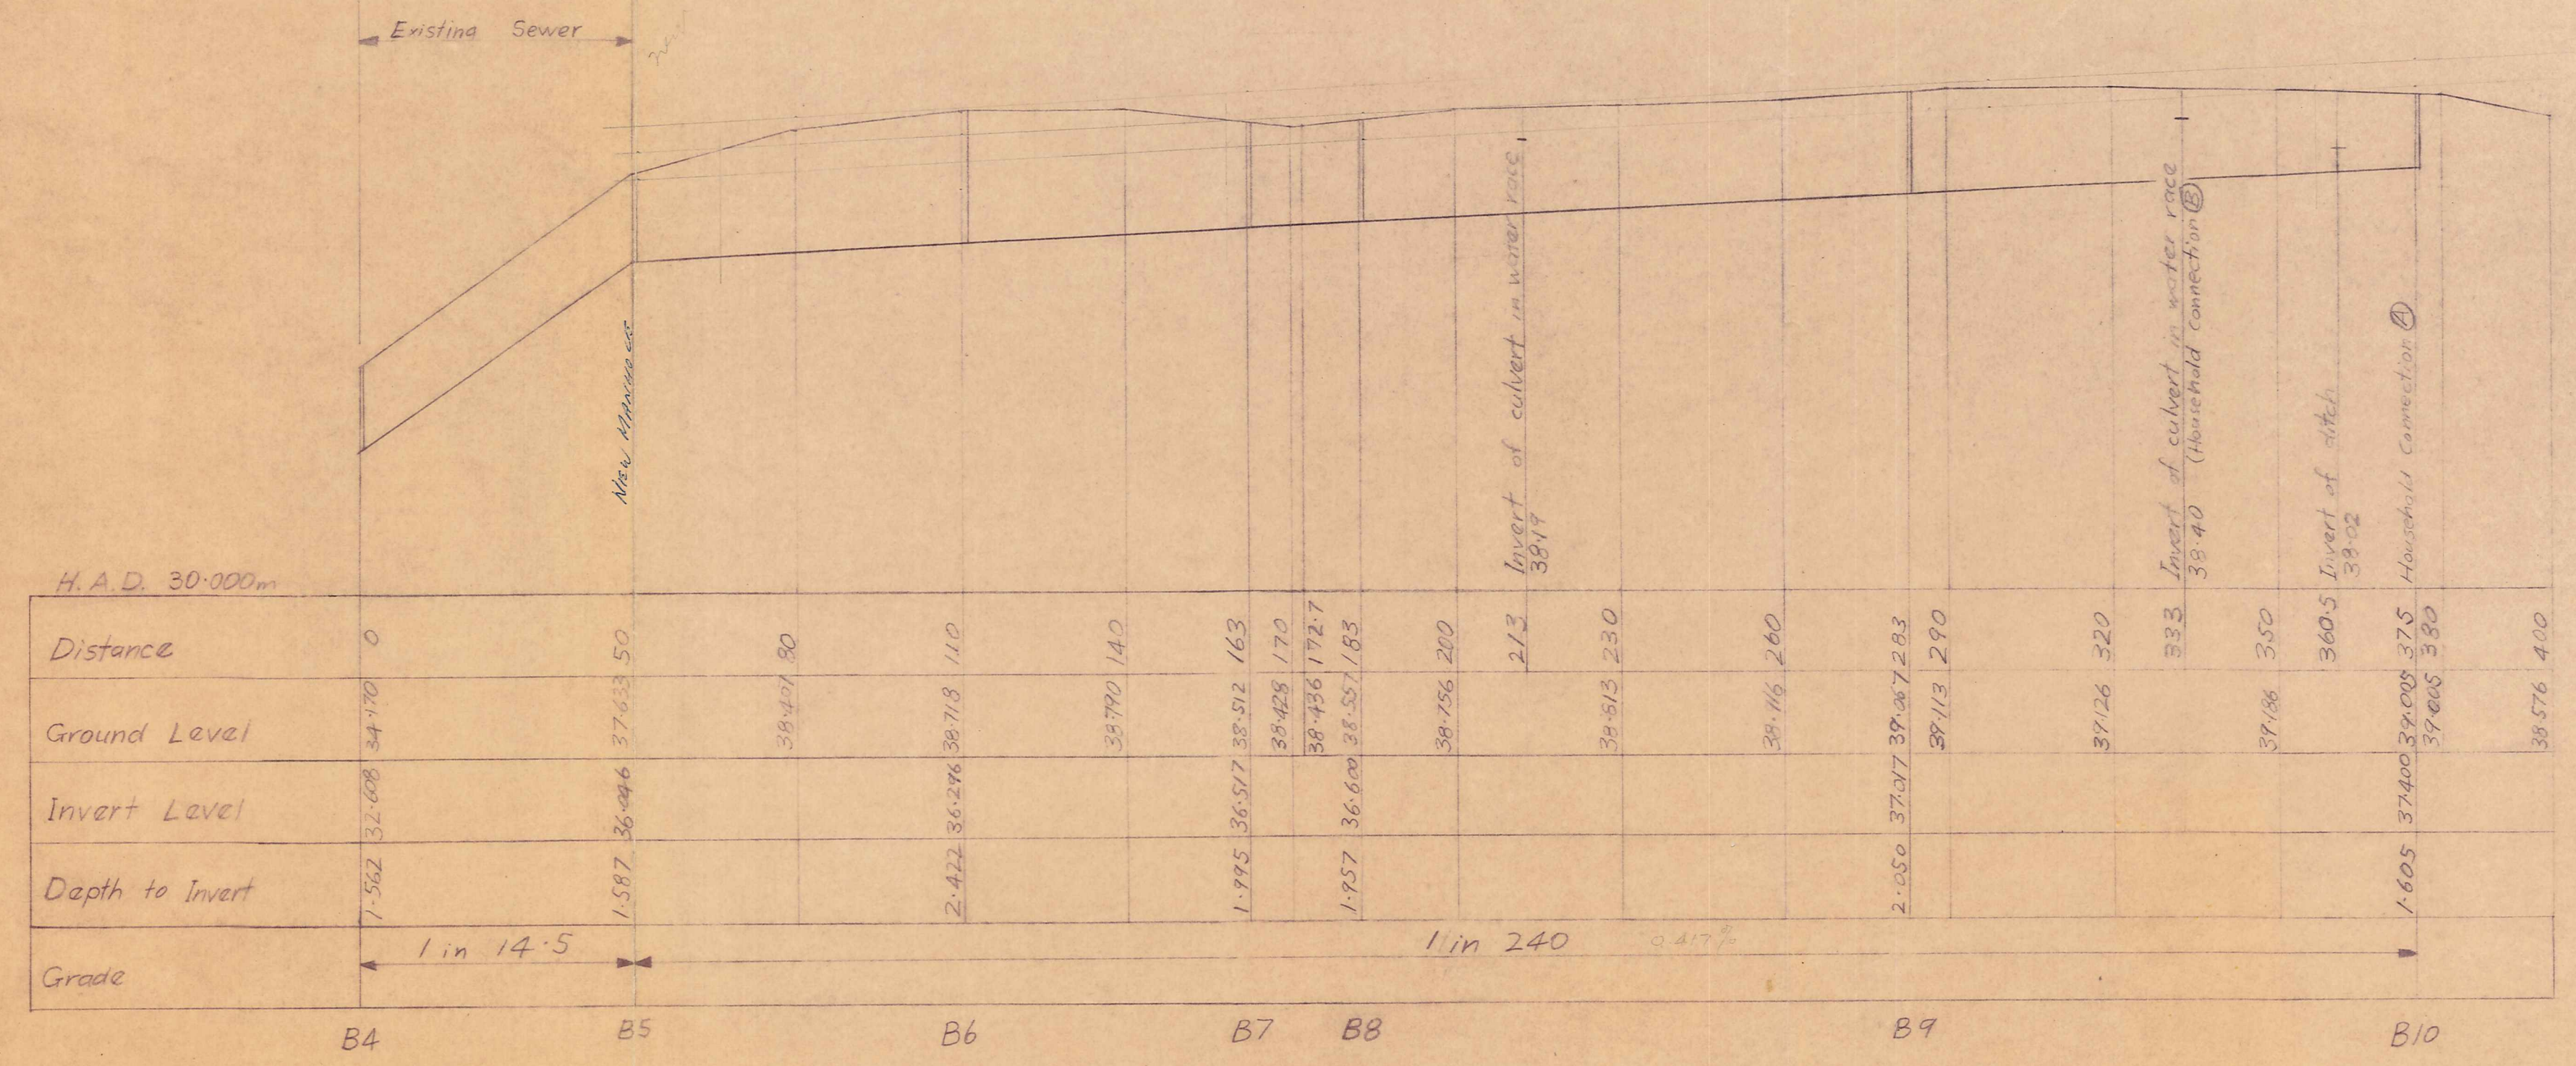

~PROFILE~
Scales Horiz. 1:1000
Vert. 1:100

- Notes
- Household connection (A) to be laid to minimum grade of 1 in 60 and to have a concrete surround where cover is less than 450 above crown of pipe
 - Household connection (B) to be laid at a grade sufficient for the pipe to pass beneath the drainage ditch.
 - Sewer beneath railway line (B7-B8) to be laid in a RC duct CLASS 2 pipe

DUFFILL WATTS & KING LTD
CONSULTING CIVIL & STRUCTURAL ENGINEERS
Dunedin P.O. Box 5289 Ph. 77-133 Invercargill P.O. Box 576 Ph. 83049
Balclutha P.O. Box 220 Phone 1425

VINCENT COUNTY
COUNCIL

SEWER EXTENTION WHITE ROAD
OMAKAU

DATUM
Omakau
Coverage
ORIGIN
1/2 M.H. B4
metric drawing

AMENDMENTS			Appvd.
NO.	BY	DATE	

NAME	DATE
BT Kingston	May '76

JOB NO.	7632	Sheet No.	1
		of	shts