



Moster Valve.
Note:- This valve controls the complete system.

Note
Distances are to be read as distances shown from boundary or building line to ϕ of supply pipe.

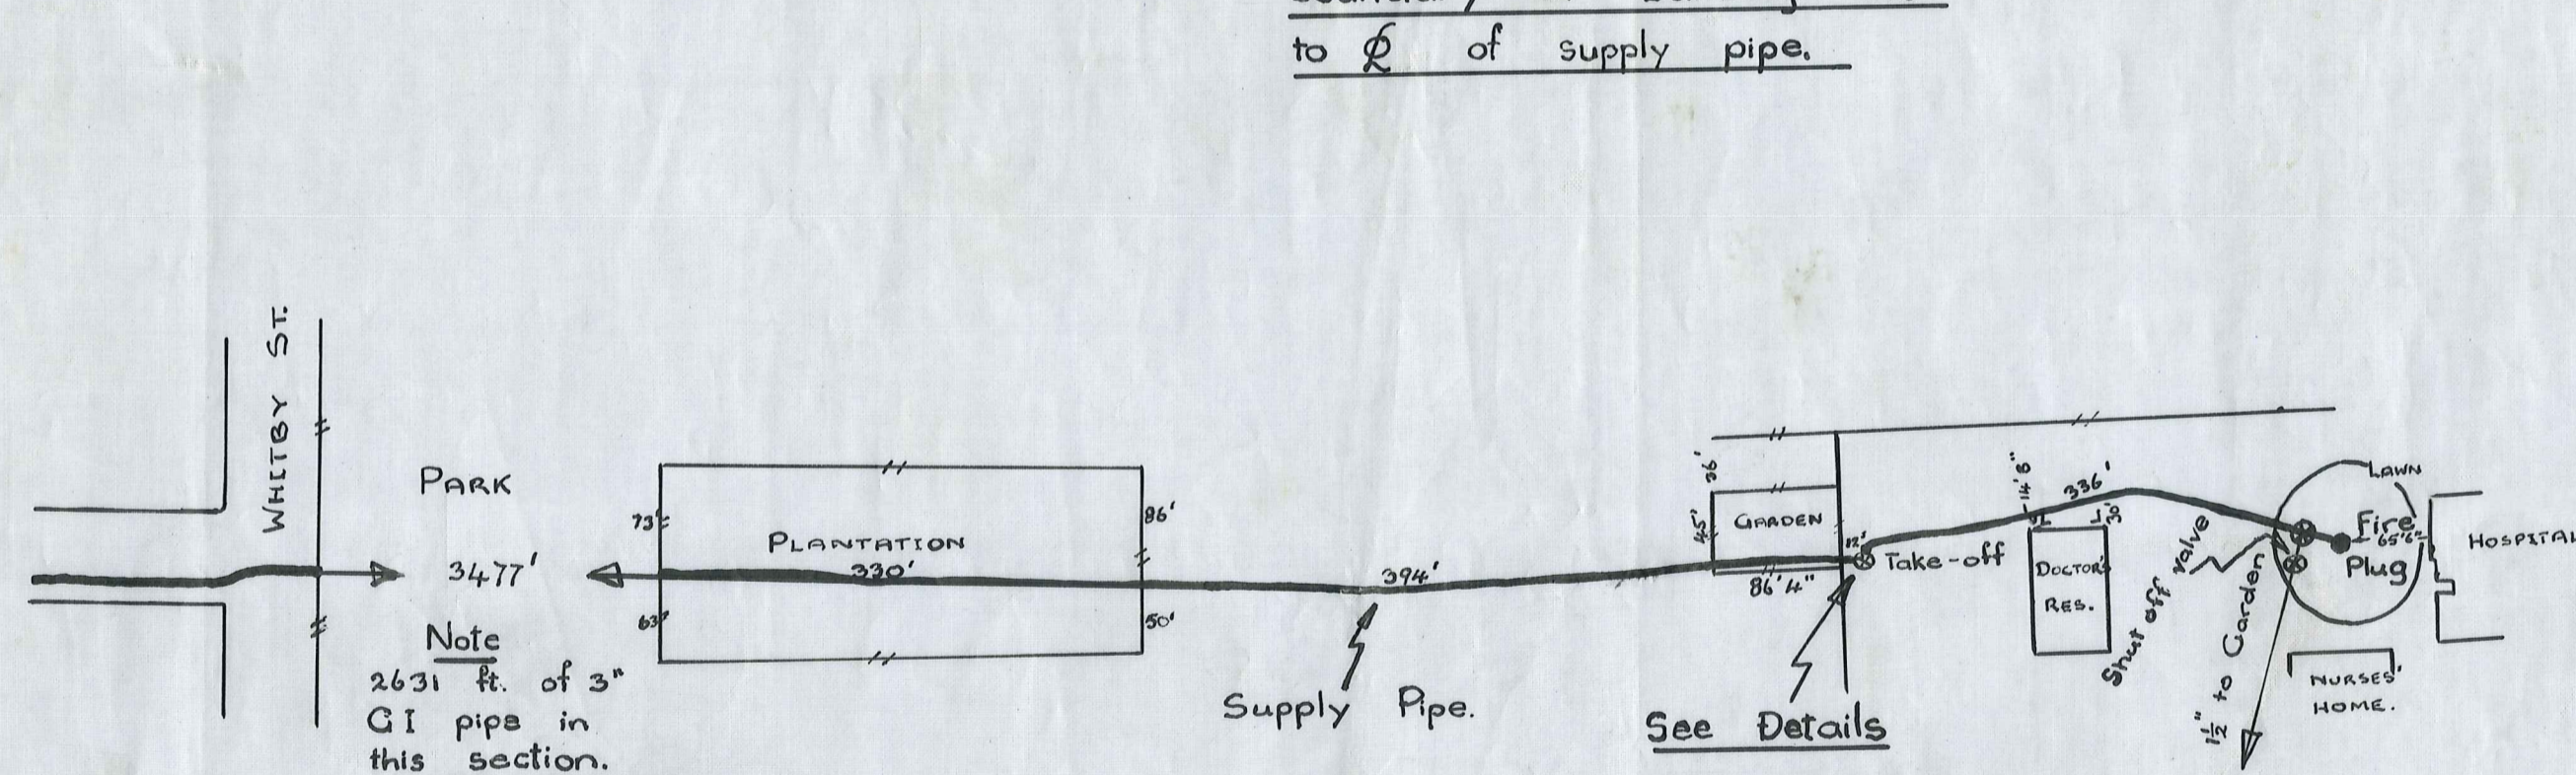

Note
2631 ft. of 3\"/>

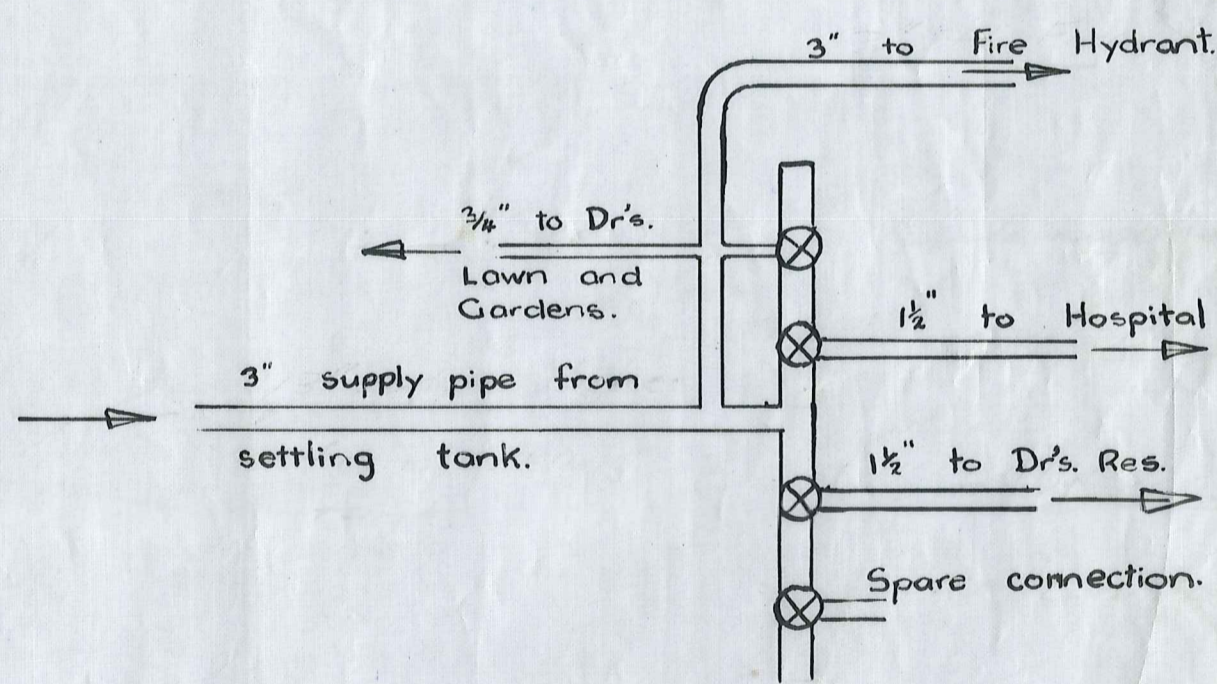

Details of "Take-Off"
Not to Scale

Details of Supply

Size of pipes - 4" for 100' then 3" for 5400'
Supply - - Approx. 100,000 G.P.D.
Pressure - Average 40 lbs \square "

Fire Emergency

In event of fire max. pressure is obtained at fire hydrant by closing all valves at "take-off" point and "shut off" valve to garden supply.

V.C.C. 23

12/12/53

DUNSTAN HOSPITAL
Details of Water Supply and
location of Pipe Line.

136/7

Scale - 2 chs to 1"